


**FAE14SSR**



**Noiseless 2-channel single room control, 400W. 2 solid state relays not potential free. Bidirectional. Only 0.1 watt standby loss.**

Modular device for DIN-EN 60715 TH35 rail mounting. 1 module = 18mm wide, 58mm deep.

**Connection to the Eltako-RS485 bus. Bus cross wiring and power supply with jumper.**

If both relays are switched on, a power of 0.4 watts is required.

**The rated switching capacity of 400W is applied for one contact and also for the sum of the two contacts.**

From production week 35/16 with automatic electronic over temperature shutdown.

With a load < 1W a GLE must be switched parallel to the load.

First teach in the sensors **using the rotary switches.**

The channels can be taught-in together at the same time. Use the lower rotary switch in positions 1+2. Alternatively, they can be taught-in separately in position 1 or 2.

Then set the operating mode using the middle rotary switch:

**PWM 1** for valves with thermoelectric actuator, T = 4 minutes.

**PWM 2** for valves with motor-driven actuator, T = 15 minutes.

**2-Pt** for 2-point control.

**PWM control mode:** The upper rotary switch sets the required temperature difference at which the device is switched on at 100%.


When the actual temperature  $\geq$  reference temperature, the device is switched off.

When the actual temperature  $\leq$  (reference temperature – hysteresis), the device is switched on at 100%.

When the actual temperature is between (reference temperature – hysteresis) and the reference temperature, the device is switched on and off by a PWM in steps of 10% depending on the temperature difference. The lower the temperature difference, the shorter the switch-on time. As a result of the settability of the 100% value, the PWM can be adapted to the radiator size and inertia. The signs are the opposite in cooling mode.

In heating mode, the **frost protection function** is always enabled. As soon as the actual temperature drops below 8°C, the temperature is controlled in the selected operating mode to 8°C.

**Function rotary switches**

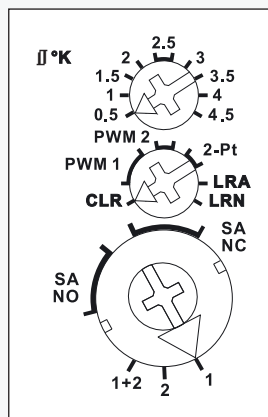

Standard setting ex works.

**Two-point control mode:** The upper rotary switch sets the required difference between the switch-on and switch-off temperatures. When the actual temperature  $\geq$  reference temperature, the device is switched off.

When the actual temperature  $\leq$  (reference temperature – hysteresis), the device is switched on.

The signs are the opposite in cooling mode.

The type of connected actuators will be selected with the **lower rotary switch. SANC** for actuator NC (normally closed) or **SANO** for actuator NO (normally open).

When **wireless window/door contacts FTK or window handle sensors FFG7B-rw** are taught-in, they are OR linked. If one or more windows are open, the output remains off. In heating mode, however, the frost protection remains enabled.

When **motion detectors FBH** are taught-in, they are AND linked. If all FBHs signal 'No motion', the device switches to standby setback mode: In heating mode, the reference temperature is set back by 2°; in cooling mode, it is raised by 2°. As soon as a motion detector signals movement again, the device is switched to normal mode.

When the **FBHs and wireless pushbuttons** are taught-in, the last telegram received is always the one that is valid. An FBH therefore switches off a setback mode selected by means of the wireless pushbutton when motion is detected.

When a **wireless pushbutton** is taught-in, the 4 keys are assigned the following functions:

Top right: Normal mode (can also be enabled by timer with the function 'ON'). Bottom right: Night setback mode by 4°; in cooling mode: increase by 4° (can also be enabled by timer with the function 'OFF'). Top left: Standby setback mode by 2°, in cooling mode, increase by 2°. Bottom left: Off (in heating mode, frost protection enabled; in cooling mode permanent off).

**Malfunction mode:** If no wireless telegram will be received from a temperature sensor for more than 1 hour, the LED lights up and it will be switched to **fault mode:** in heating mode it will be switched on for 1.2 minutes and switched off for 2.8 minutes at PWM 1. At PWM 2 and 2-Pt the times are 4,5 minutes 'on' and 10.5 minutes 'off'. The device is switched off in cooling mode. When a wireless telegram is again received, the LED goes out and the device switches back to normal mode.

**The LED** below the upper function rotary switch performs during the teach-in process according to the operating instructions. It shows control commands by short flickering during operation.

**FAE14SSR**

RS485 bus actuator with solid state relay

EAN 4010312314173

**59,20 €/pc.**